

CUSTOMER DRAWING

PART NO.

SEE TABLE


NO.	PART NO.	도체 규격 (SQ)	전선 외경 (mm ²)	WIRE SEAL
1	ST741276-3(SS)	0.13 ~ 0.22	0.90 ~ 1.30	-
2	ST741277-3 (S)	0.3 ~ 0.5	1.40 ~ 1.70	MG683894 [BLUE]
			1.80 ~ 2.20	MG683895 [RED]
3	ST741278-3 (M)	0.85 ~ 1.25	2.20 ~ 2.50	MG683896 [BLACK]
			2.60 ~ 2.90	MG683897 [GREEN]

PART NO.	WIRE BARREL		INSULATION BARREL	
	W1	H1	W2	H2
ST741276 (SS)	1.9	(2.05)	6.0	4.8
ST741277 (S)	2.4	2.3	6.0	4.8
ST741278 (M)	3.2	2.9	6.0	4.8

GENERAL TOLERANCE (TERMINAL)						USED ON
10 MAX	20 MAX	45 MAX	45 VR	ANGLE	ECCENT	
±0.2	±0.25	±0.3	±0.5	±30'	0.1	

주 기

- 제품 기능상 유해한 BURR 및 변형등이 없을 것.
- 적용 상대 FEMALE TERMINAL : ST731273(SS)/1274(S)/1275(M)
- 제품내 함유된 6대 유해물질 (납,수은,카드뮴,6가크롬, PBBs,PBDEs)은 EU ELV 지침 및 RoHS 법규에서 지정한 최대 허용 농도를 초과해서는 안된다.

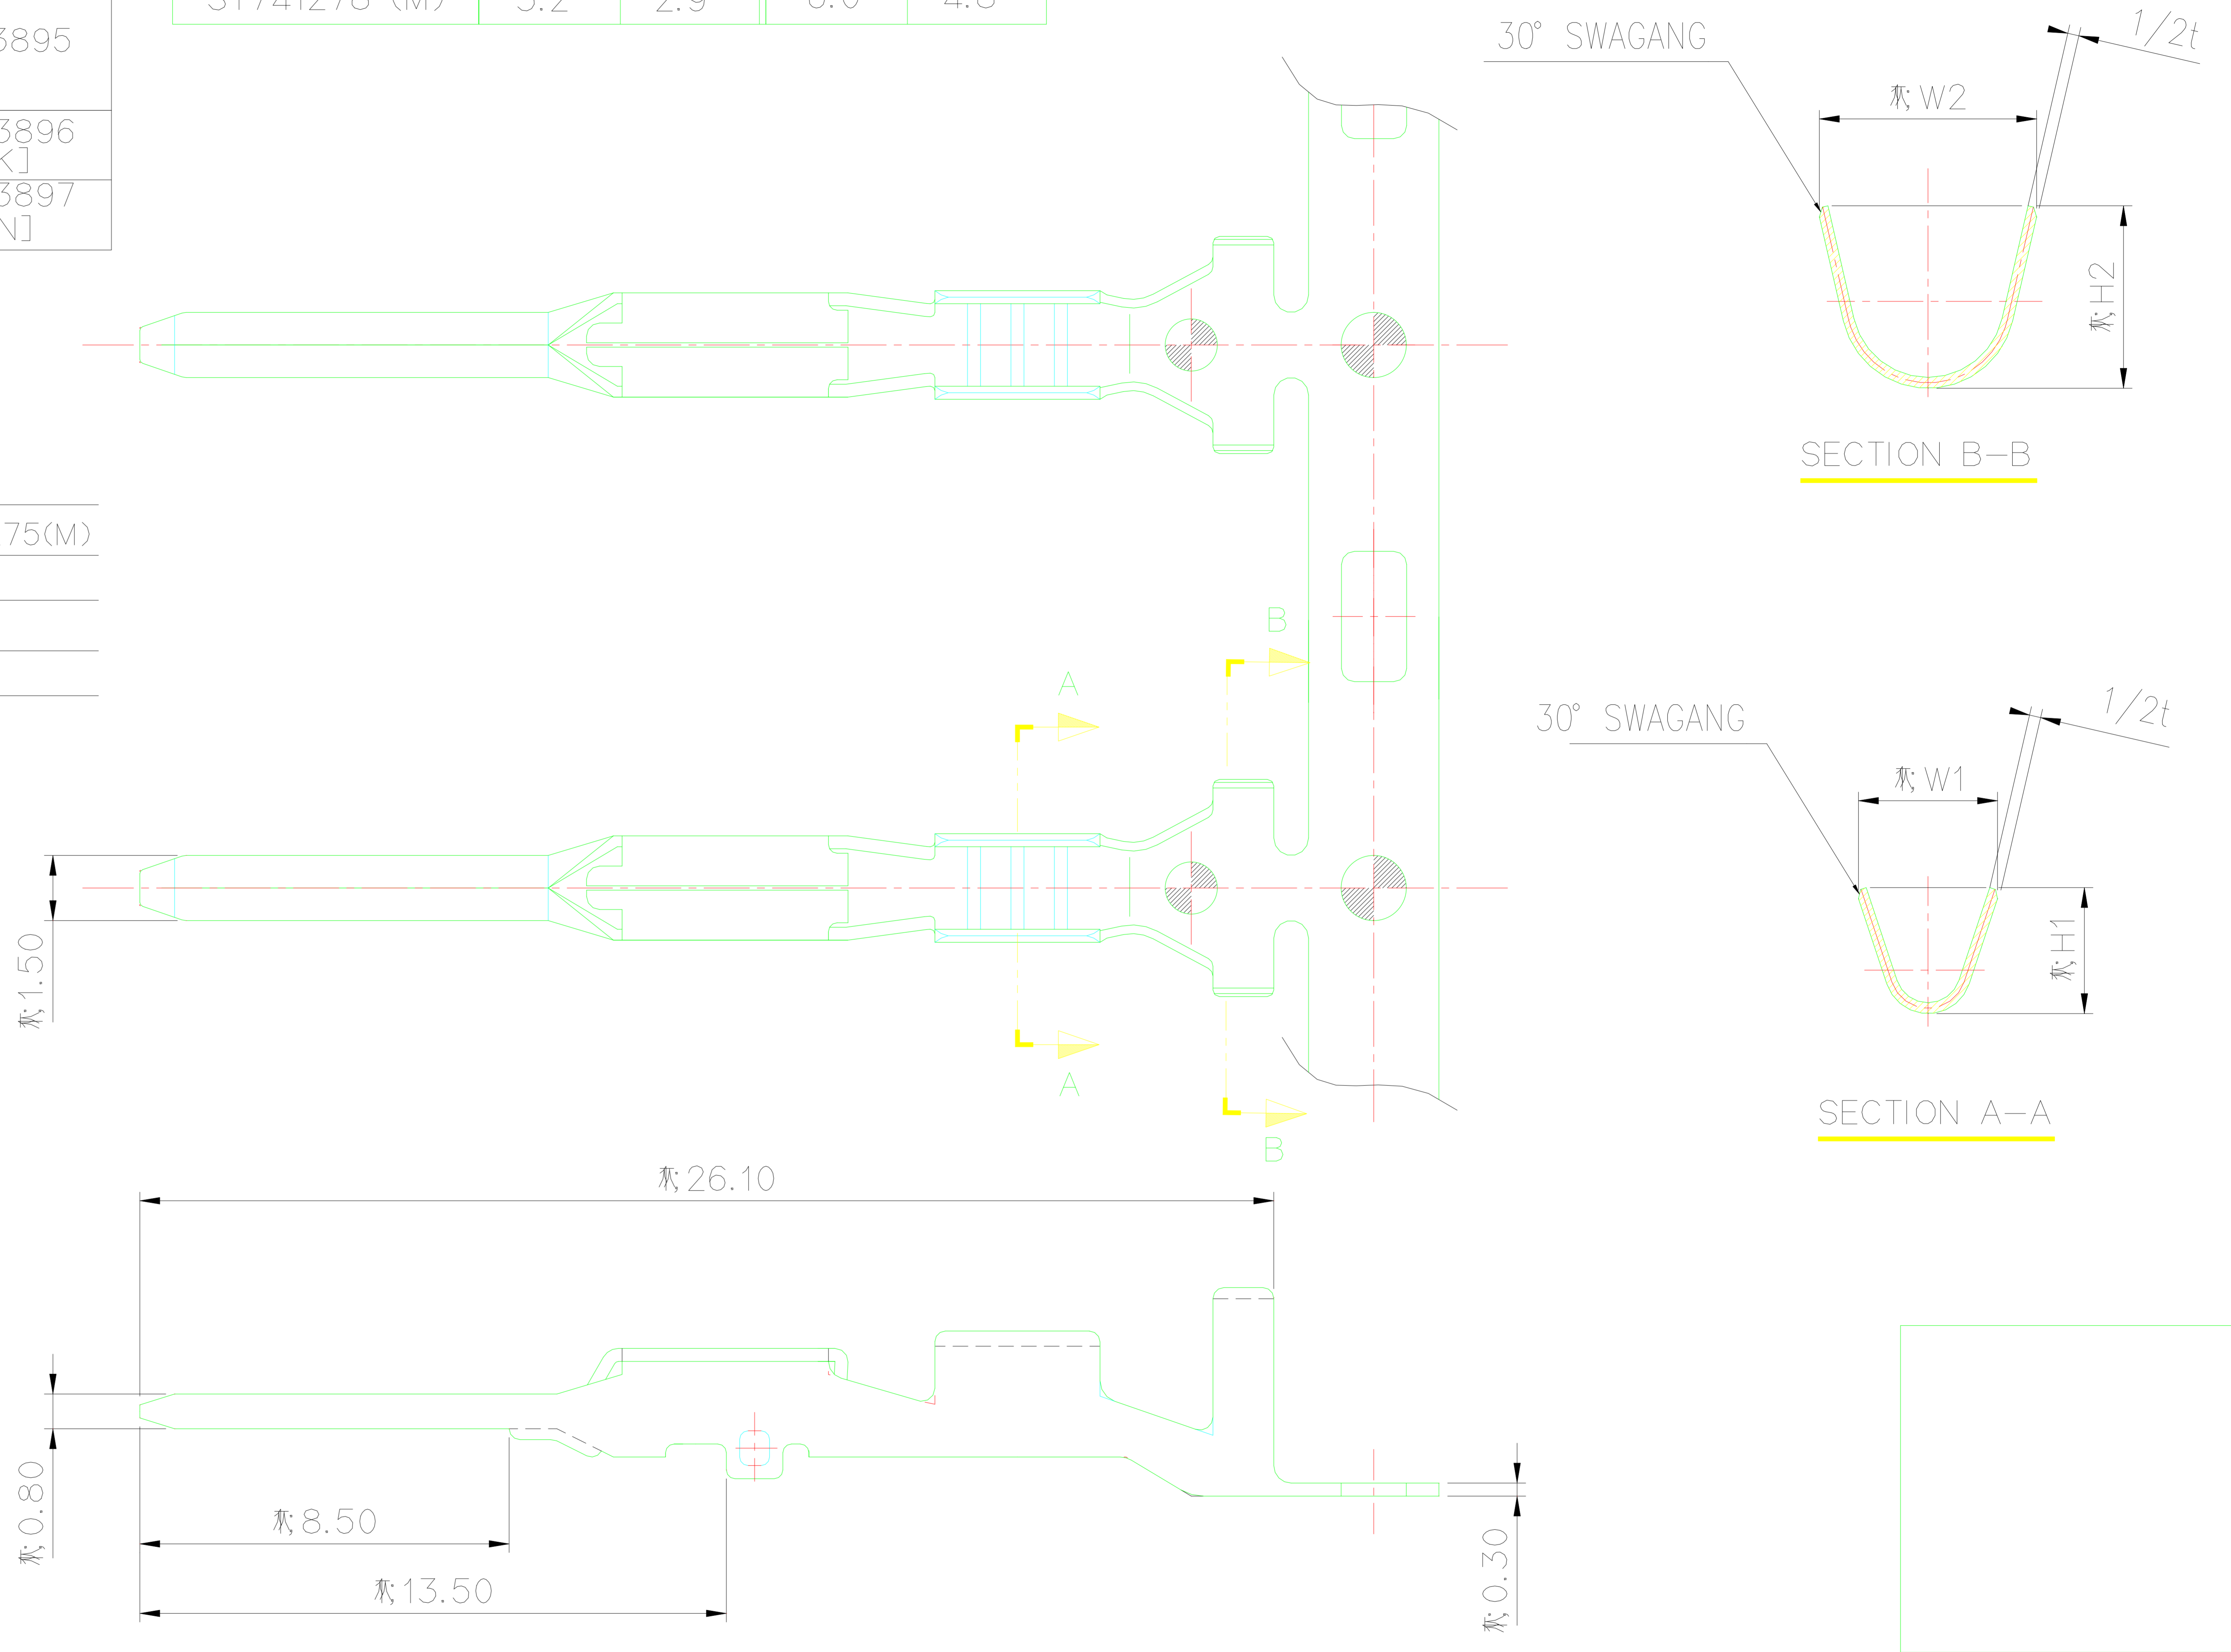

NOTE

- MUST BE FREE OF BURR AND IMPERFECTION THAT AFFECT FUNCTION.
- APPLICABLE FEMALE TERMINAL : ST731273(SS)/1274(S)/1275(M)
- 6 HAZARDOUS SUBSTANCES IN PARTS (LEAD,MERCURY, CADMIUM,HEXAVALENT CHROMIUM,PBBs,PBDEs) SHALL NOT EXCEED THE MAXIMUM PERMISSIBLE CONCENTRATION PRESCRIBED UNDER EU ELV DIRECTIVE & RoHS REGULATION.

ISSUE MARK

MATERIAL	Copper Alloy	KET KOREA ELECTRIC TERMINAL CO., LTD. ENGINEERED
FINISH	PRE-TIN	
WIRE RANGE		CLASS 060
INSULATION		TYPE WP
LTR	REVISION RECORD	DR. CHK. APP. DATE
DR.	HKS. '10.04.01	CHK. JYS. '10.04.01
CHK.		APP. KJ. '10.04.01
TOLERANCE EXCEPT AS NOTED	SEE TABLE	SCALE 5/1
PART NAME	060 MALE WP TERMINAL (SS, S, M)	
PART NO.	SEE TABLE	

DIMENSIONS IN MM